

REACTION TO FIRE CLASSIFICATION REPORT

No. RA04-0217

ACCORDING TO THE EUROPEAN STANDARD NF EN 13501-1

Provided for in the Ordinance from the Ministry of the Interior, November 21st, 2002.
Pilot laboratory approved by the Ministry of the Interior (Ordinance of February 5th, 1959, amended)
Seule la version française fait foi.
Only the French version is legally acceptable.

Valid 5 years as from April 28th, 2004

Owner : GIRPI
Rue Robert Ancel
76700 HARFLEUR

Commercial brand(s) : SYSTEME DE CANALISATION GIRAIR

Description : Piping system consisting of polyvinyl chloride pipes and fittings welded together using the welding polymer « GAFIX ».

Nominal diameters : 40 mm and 110 mm.
Nominal thicknesses : 3.7 mm (Ø 40 mm) and 10 mm (Ø 110 mm).
Nominal density : 1300 kg/m³.
Colour : blue.

Euroclass : **B-s1, d0 valid for the tested thicknesses and diameters**

The indicated classification does not prejudice the conformity of marketed materials with the samples submitted to the tests and under no circumstances, this document should not be considered as type approval or certification of the product in the sense of the L 115-27 article of the consumption code and the law dated of June 3rd, 1994.
It comprises 2 pages. The reproduction of this classification report is only authorised in its integral form, with or without its test report attached.


Champs/Marne, April 28th, 2003

Technician
Responsible for the test



Gildas CREACH

Head of the "Reaction to Fire"
Laboratory

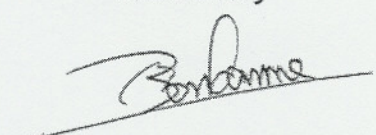

Martial BONHOMME